NOTES:

1. PROVIDE STAINLESS STEEL COVER PLATES FOR ALL EXIST J-BOXES EXPOSED AS A RESULT OF REMOVING EXISTING FIXTURES OR WIRING DEVICES.
2. REMOVE EXISTING FIXTURES TO ALLOW FOR INSTALLATION OF NEW CEILING. REINSTALL FIXTURES IN NEW LOCATIONS AS INDICATED. REUSE EXISTING CIRCUITS. PROVIDE BOXES, CONDUIT AND CONDUCTORS AS REQUIRED.
3. REMOVE EXISTING FIXTURES TO ALLOW FOR INSTALLATION OF NEW CEILING. REPLACE FIXTURES AFTER CEILING WORK HAS BEEN COMPLETED. PROVIDE BOX EXTENSIONS, SPACERS, AND CONDUCTORS AS NECESSARY TO RESTORE OPERATION. COORDINATE WITH OTHER TRADES.

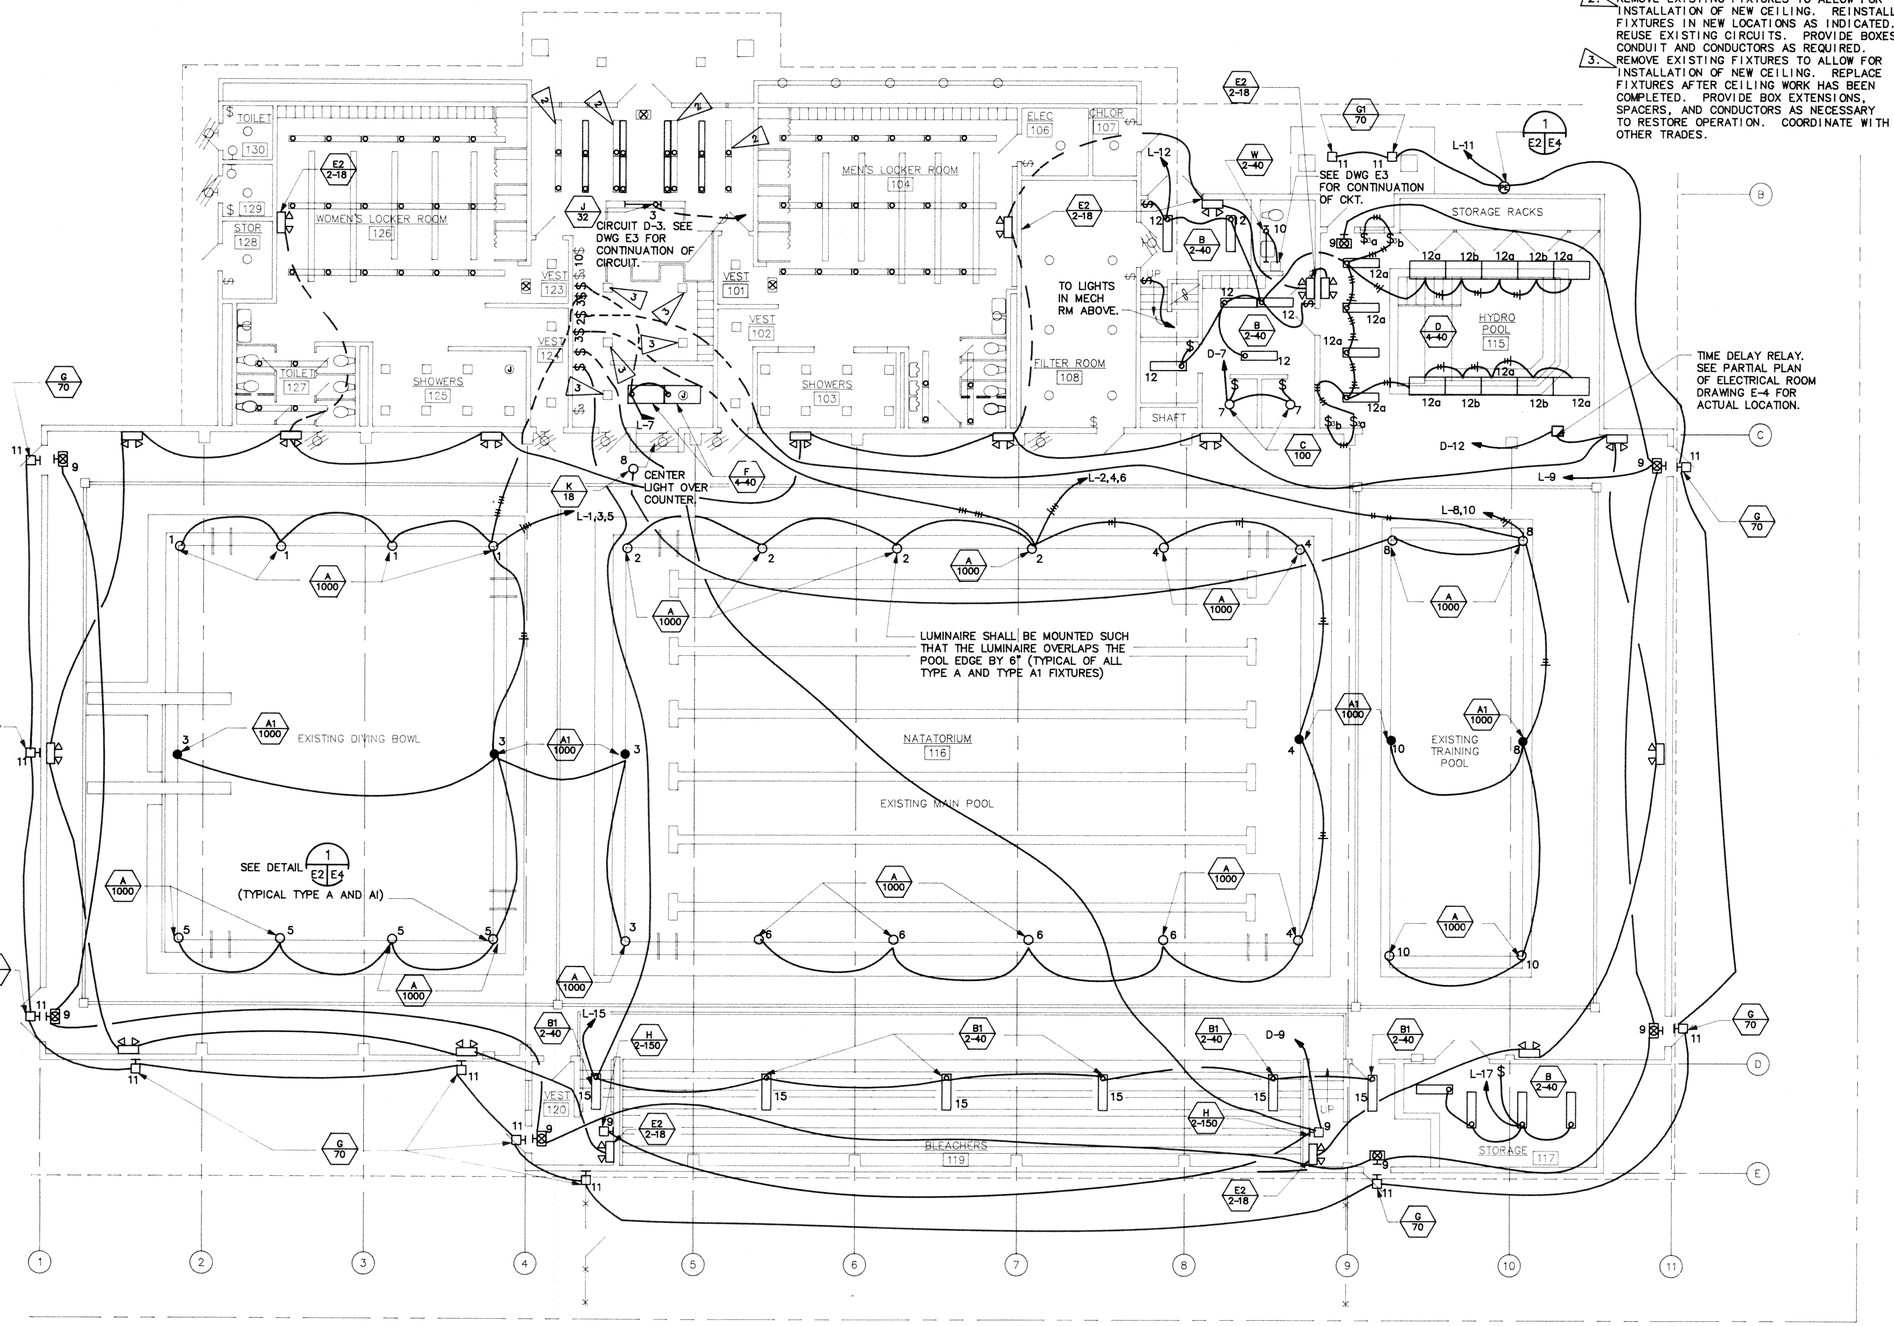

LIGHTING PLAN

SCALE: 1/8" = 1'-0"

MARK D. ROBISON — STATE OF WASHINGTON — REGISTERED PROFESSIONAL ENGINEER

AMERICAN INSTITUTE OF ARCHITECTS

abacus CONSULTANTS, P.S.
318 occidental avenue south suite 200
seattle, washington 98104 (206) 583-0200

HAL MOE POOL ENCLOSURE

LIGHTING PLAN

THE TSANG PARTNERSHIP, INC.
☐ SEATTLE ☐ TACOMA
1221 SECOND AVENUE SUITE 330 SEATTLE, WA 98101 (206) 343-3044 FAX (206) 684-9599
748 MARKET STREET SUITE 300 TACOMA, WA 98402 (206) 272-9383 FAX (206) 383-8059

DATE: 8-7-89

REVISED:

SHEET NO.: E2

© COPYRIGHTS RESERVED